


Plibrico Company Boiler Application Guide

Water Tube Boilers

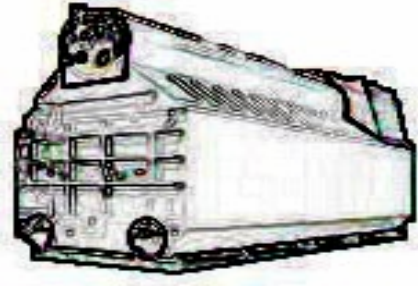


Burner Throat
Normal Service
 Plibrico Super F AB
High Duty Service
 Plibrico 60 AB
Severe Service
 Plibrico 85 S SP

Refractory Seal
 Plicast Trowl Mix

Burner Wall
Normal Service
 Plicast Tuff Mix
 Plibrico Super F AB
High Duty Service
 Plicast 31
Severe Service
 Plicast KL 3000
 Plibrico 60 AB


Tangent Tube (backup)
Normal Service
 Plicast Airlite
High Duty Service
 Plicast LWI 20
Severe Service
 Plicast Trowl Mix +
 Plisulate 1900 Block

Boiler Floor
Normal Service
 Plicast Tuff Mix
High Duty Service
 Plicast 31
Severe Service
 Plicast KL 3000

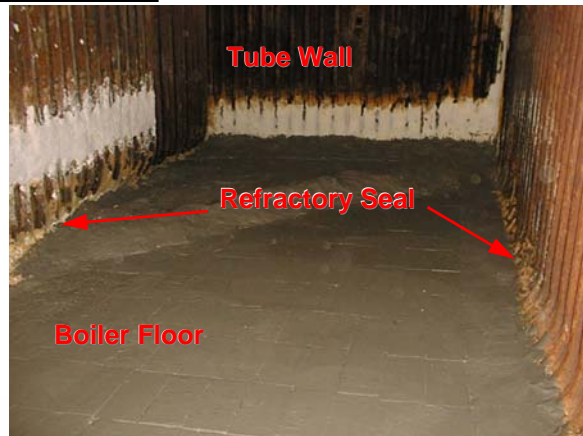


Application Note


Plibrico Water Tube Boiler Monolithic Refractory Details

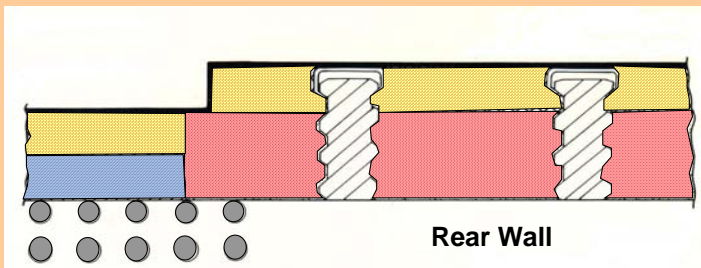


Convection Section

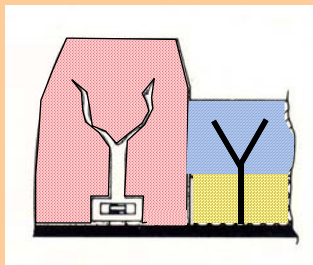

Burner Front Wall

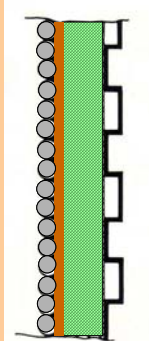

Tangent Tube Wall

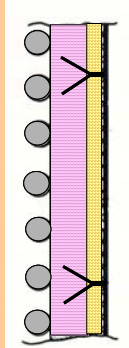

Plibrico Company LLC
 1010 North Hooker Street
 Chicago, Illinois 60622

Tel: 312-337-9000
 Fax: 312-337-9003

www.plibrico-usa.com

This application guide is intended for general information only. Please consult Plibrico Company or your local Plibrico Representative for specific application assistance and product recommendations.